


Effects of KRR Mobile PWT on Pressure Drops Across the Boiler

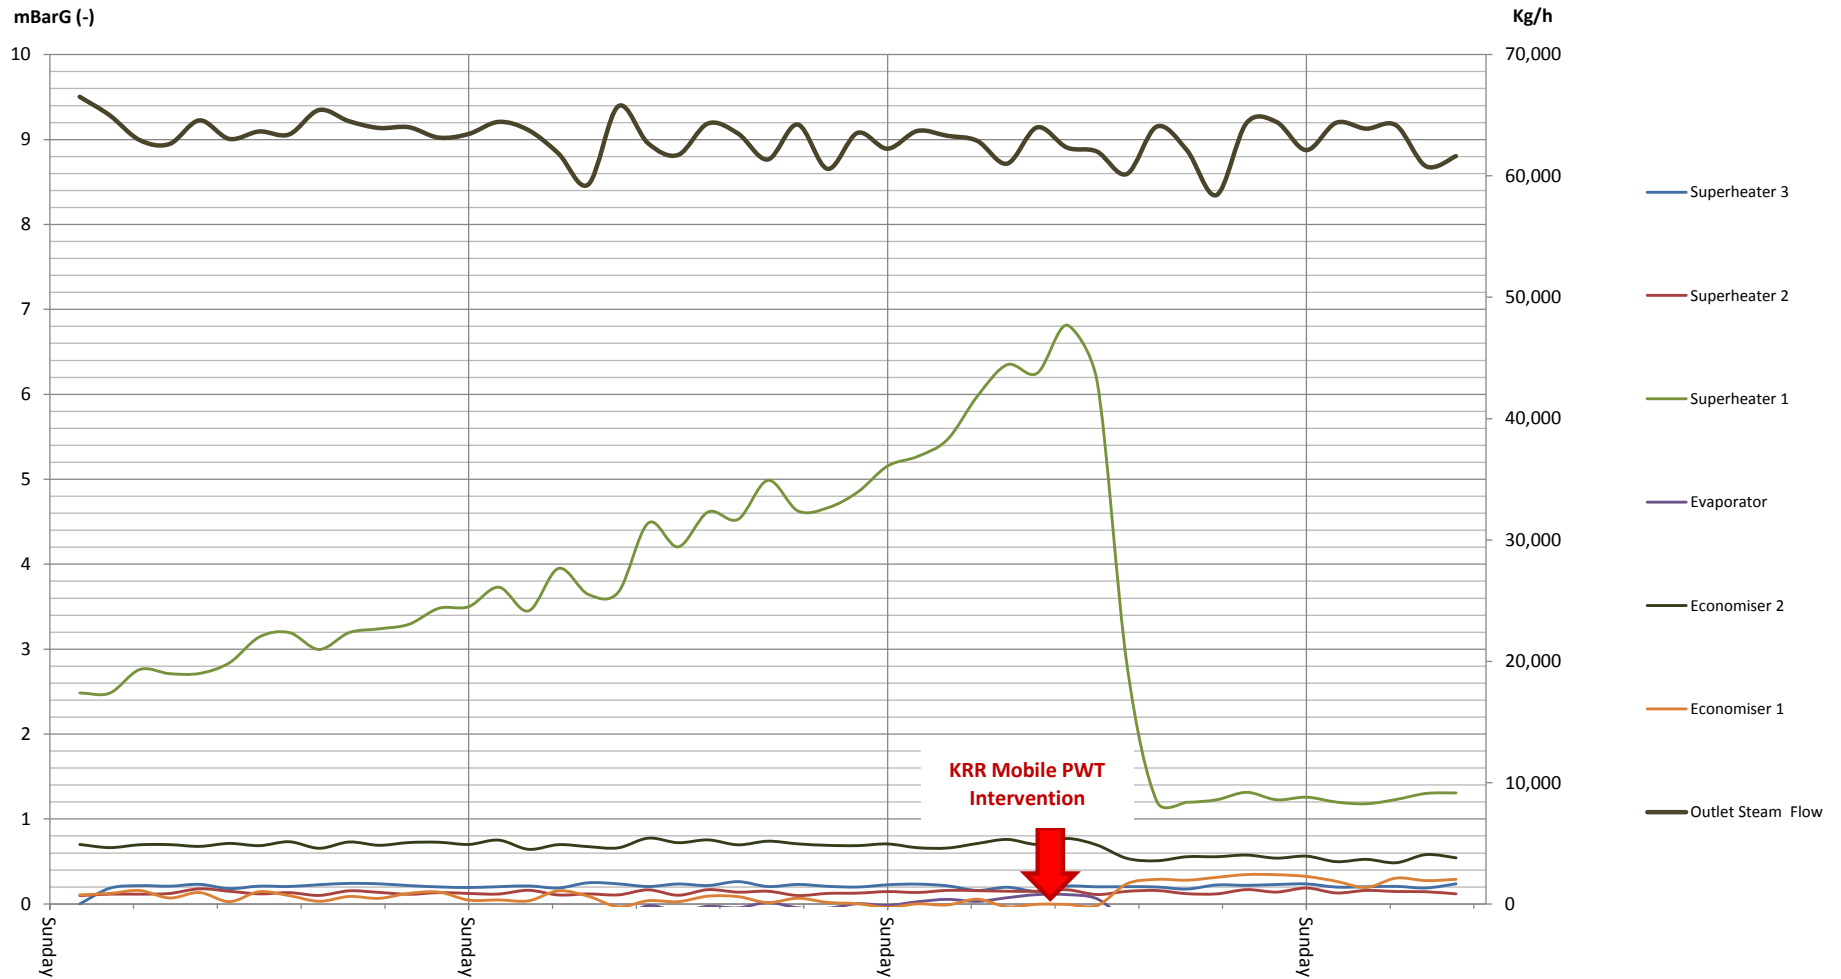

Comments: Pressure in SuperHeater 1 (SH1) continued to drop until it reached a critical level (-6.75mBar). SH1 was nearly blocked when KRR Mobile PWT was used to intervene. The intervention was successful, bringing the dP back to a normal level and eliminating the risk of a complete blockage (-1.2 mBar).